



**H0258.03-303-11-R1
ACOUSTICAL PERFORMANCE TEST REPORT
ASTM E90**

Rendered to:

CR LAURENCE CO., INC.

Series/Model: 487-AR

Type: Office Partition

Glazing: 1/4" Laminate Interior, 3-1/2" Air Space, 1/4" Tempered Exterior

STC: 46

OITC: 38

Reference should be made to Intertek-ATI Report No. H0258.03-303-11 for complete test specimen description. This page alone is not a complete report. Flanking limit tests and reference specimen tests are available upon request.



Acoustical Performance Test Report

CR LAURENCE CO., INC.
2100 East 38th Street
Vernon, California 90058

Report No	H0258.03-303-11
Test Date	04/19/17
Report Date	05/16/17
Revision 1 Date	05/26/17

Project Scope

Architectural Testing, Inc., an Intertek company ("Intertek-ATI"), was contracted to conduct a sound transmission loss test. The complete test data is included as Appendix B of this report. The client provided the test specimen.

Test Methods

Testing for this project was conducted in accordance with the following standards. The equipment listed in the attachments meets the requirements of the following standards.

ASTM E90-09(2016), *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements*

ASTM E413-10, *Classification for Rating Sound Insulation*

ASTM E1332-10a, *Standard Classification for Rating Outdoor-Indoor Sound Attenuation*

ASTM E2235-04(2012), *Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods*

Test Procedure

All measurements were conducted in the HT test chambers at Intertek-ATI located in Lake Forest, California. The sensitivity of the microphones was checked before measurements were conducted.

The transmission loss values were obtained for a single direction of measurement. Two background noise sound pressure level and five sound absorption measurements were conducted at each of five microphone positions. Two sound pressure levels were made simultaneously in the receive and source rooms at each of five microphone positions. The air temperature and relative humidity conditions were monitored and recorded during all measurements.

Specimen Installation

A sound transmission loss test was initially performed on a filler wall. The specimen plug was removed from the filler wall assembly. The specimen was placed on a foam isolation pad in the test opening. Duct seal was used to seal the perimeter of the specimen to the test opening on both sides. The interior side of the specimen, when installed, was approximately 1/4" from being flush with the receive room side of the filler wall. A stethoscope was used to check for any abnormal air leaks around the test specimen prior to testing. Operable portions of the test specimen, if any, were cycled at least five times prior to testing.

Test Calculations

Transmission loss (TL) at each 1/3 octave frequency is the average source room sound pressure level minus the average receive room sound pressure level, plus, 10 times the log of the specimen area divided by the sound absorption of the receive room with the sample in place.

STC Rating

To obtain the Sound Transmission Class (STC), read the TL of the contour curve at 500 Hz. The sum of the deficiencies below the contour curve must not exceed 32. The maximum deficiency at any one frequency must not exceed 8.

OITC Rating

The Outdoor-Indoor Transmission Class (OITC) is calculated by subtracting the logarithmic summation of the TL values from the logarithmic summation of the A-weighted transportation noise spectrum stated in ASTM E1332.

Specimen Descriptions

		Frame
Size		78-7/8" by 78-7/8"
Thickness		5-1/4"
	Corners	Mitered and Butted
	Fasteners	Screws
	Seal Method	N/A
Material		Aluminum
	Reinforcement	N/A
	Thermal Break Material	N/A
Daylight Opening Size		75-1/2" by 36-5/8"

* - Stated per Client/Manufacturer, N/A-Not Applicable

Specimen Descriptions (Continued)

Measured Overall Interior Glass Thickness	0.115", 0.060" PVB, 0.115"
Interior Glass Type	Laminate
Measured Overall Exterior Glass Thickness	0.223"
Exterior Glass Type	Tempered

Components

Type	Quantity	Location
Weatherstrip		
No weatherstrip		
Hardware		
No hardware		
Drainage		
No drainage		

Total Weight (lbs)	Average Weight (lbs/ft²)
286	6.45

* - Stated per Client/Manufacturer, N/A-Not Applicable

Comments

A drawing of the test specimen is included in Appendix D. The specimen was returned per the client's request.

Intertek-ATI will service this report for the entire test record retention period. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained by Intertek-ATI for the entire test record retention period. The test record retention period ends four years after the test date.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. It is the exclusive property of the client so named herein and relates only to the specimen tested. This report is intended to help in the client's quality assurance program, but it does not represent a continuous or exhaustive evaluation of the specimen tested or of other products or materials that were not evaluated. The statements and data provided herein do not constitute approval, disapproval, certification, or acceptance of performance or materials.

This report may not be reproduced, except in full, without the written approval of Intertek-ATI.

For INTERTEK-ATI:

Leeland S. Hoover
Technician I - Acoustical Testing

Bradlay D. Hunt
Laboratory Manager – Acoustical Testing

LSH:bd/ss

Attachments (pages): This report is complete only when all attachments listed are included.

- Appendix A: Equipment description (1)
- Appendix B: Complete test results (2)
- Appendix C: Photographs (1)
- Appendix D: Drawings (3)

Revision Log

<u>Rev. #</u>	<u>Date</u>	<u>Page(s)</u>	<u>Revision(s)</u>
R0	05/16/17	N/A	Original Report Issue
R1	05/26/17	Appendix D	Corrected drawing



H0258.03-303-11-R1

Appendix A



H0258.03 -303-11

Appendix A

Instrumentation:

Instrument	Manufacturer	Model	Description	ATI Number	Date of Calibration
Data Acquisition Chassis	National Instruments	PXI-1033	Data Acquisition Chassis	INT00392	10/16
Data Acquisition Card	National Instruments	PXI-4462	Data Acquisition Card	INT00395	10/16
Data Acquisition Card	National Instruments	PXI-4462	Data Acquisition Card	INT00396	10/16
Data Acquisition Card	National Instruments	PXI-4462	Data Acquisition Card	INT00397	10/16
Source Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00249	04/17
Source Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00250	04/17
Source Room Microphone	PCB Electronics	378B20	Microphone and Preamplifier	INT00251	04/17
Source Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00252	04/17
Source Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00248	04/17
Receive Room Microphone	PBC Piezotronics	378B20	Microphone and Preamplifier	INT00229	03/17
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00230	03/17
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00231	03/17
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00232	03/17
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00233	03/17
Receive Room Environmental Indicator	Comet	T7510	Receive Room	INT00299	10/16
Source Room Environmental Indicator	Comet	T7510	Source Room	INT00300	10/16
Microphone Calibrator	Norsonic	1251	Pistonphone Calibrator	00288	04/16

*- Note: The calibration frequency for this equipment is every two years per the manufacturer's recommendation.

Test Chamber:

	Volume	Description
Receive Room	231 m ³	Rotating vane and stationary diffusers Temperature and humidity controlled Isolation pads under the floor
Source Room	200 m ³	Stationary diffusers only and humidity controlled

	Maximum Size	Description
TL Test Opening	4.27 m wide by 3.05 m high	Vibration break between source and receive rooms

N/A-Non Applicable



H0258.03-303-11-R1

Appendix B

Complete Test Results



AIRBORNE SOUND TRANSMISSION LOSS
ASTM E 90

Test Date	04/19/17						
Data File No.	H0258.03						
Client	CR Laurence Co., Inc.						
Description	Series/Model: 487-AR Aluminum Office Wall with 1/4" laminate, 3-1/2" air space, 1/4" tempered						
Specimen Area	4.12 m ²	Receive Temp.	22.8 °C		Source Temp.	22.2 °C	
Technician	Bradlay Hunt	Receive Humidity	54%		Source Humidity	56%	


Freq (Hz)	Background SPL (dB)	Absorption (m ²)	Source SPL (dB)	Receive SPL (dB)	Specimen TL (dB)	95% Confidence Limit	Number of Deficiencies
80	36.5	4.8	104	76	28.6	1.73	-
100	32.5	5.1	106	80	26.4	1.82	-
125	37.7	5.0	105	74	32.1	1.13	0
160	42.3	5.2	103	71	32.2	0.94	1
200	35.3	6.2	106	72	32.9	0.76	3
250	21.7	6.9	106	67	37.0	0.68	2
315	17.3	6.9	107	65	39.3	0.30	3
400	18.7	6.1	107	66	39.1	0.61	6
500	20.4	5.4	108	62	44.5	0.68	1
630	17.1	5.7	106	58	46.2	0.41	1
800	17.3	5.9	106	54	50.7	0.31	0
1000	10.2	6.2	107	54	50.9	0.42	0
1250	6.8	6.4	106	54	50.3	0.20	0
1600	5.7	6.9	103	52	48.8	0.21	1
2000	6.8	8.1	102	54	44.7	0.22	5
2500	6.4	8.8	102	54	44.7	0.22	5
3150	5.4	9.9	101	49	48.3	0.19	2
4000	5.4	11.9	99	40	54.5	0.35	0
5000	5.6	15.1	99	35	58.1	0.28	-

STC Rating **46** *(Sound Transmission Class)*
Deficiencies 30 *(Sum of Deficiencies)*
OITC Rating **38** *(Outdoor-Indoor Transmission Class)*

Notes:
 1) Receive Room levels less than 5 dB above the Background levels are red.
 2) Specimen TL levels listed in red indicate the lower limit of the transmission loss.
 3) Specimen TL levels listed in green indicate that there has been a filler wall correction applied

AIRBORNE SOUND TRANSMISSION LOSS
ASTM E 90

Test Date	04/19/17					
Data File No.	H0258.03					
Client	CR Laurence Co., Inc.					
Description	Series/Model: 487-AR Aluminum Office Wall with 1/4" laminate, 3-1/2" air space, 1/4" tempered					
Specimen Area	4.12 m ²	Receive Temp.	22.8 °C		Source Temp.	22.2 °C
Technician	Bradlay Hunt	Receive Humidity	54%		Source Humidity	56%

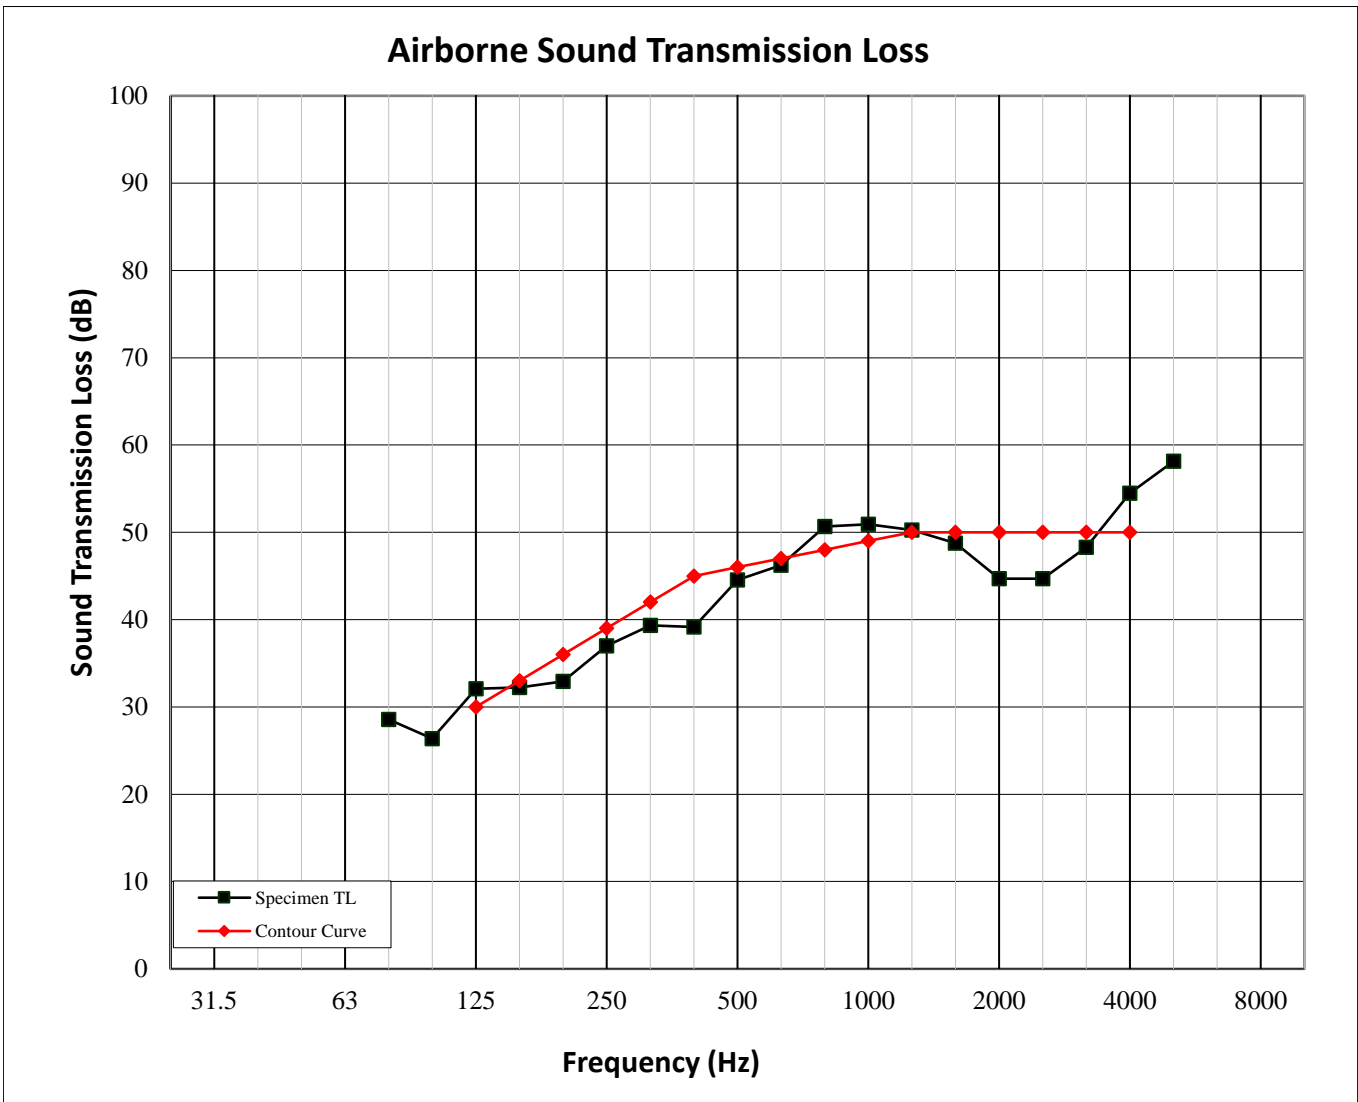

Appendix C

Photographs



Receive Room View of Installed Specimen




Source Room View of Installed Specimen



H0258.03-303-11-R1

Appendix D

Drawings

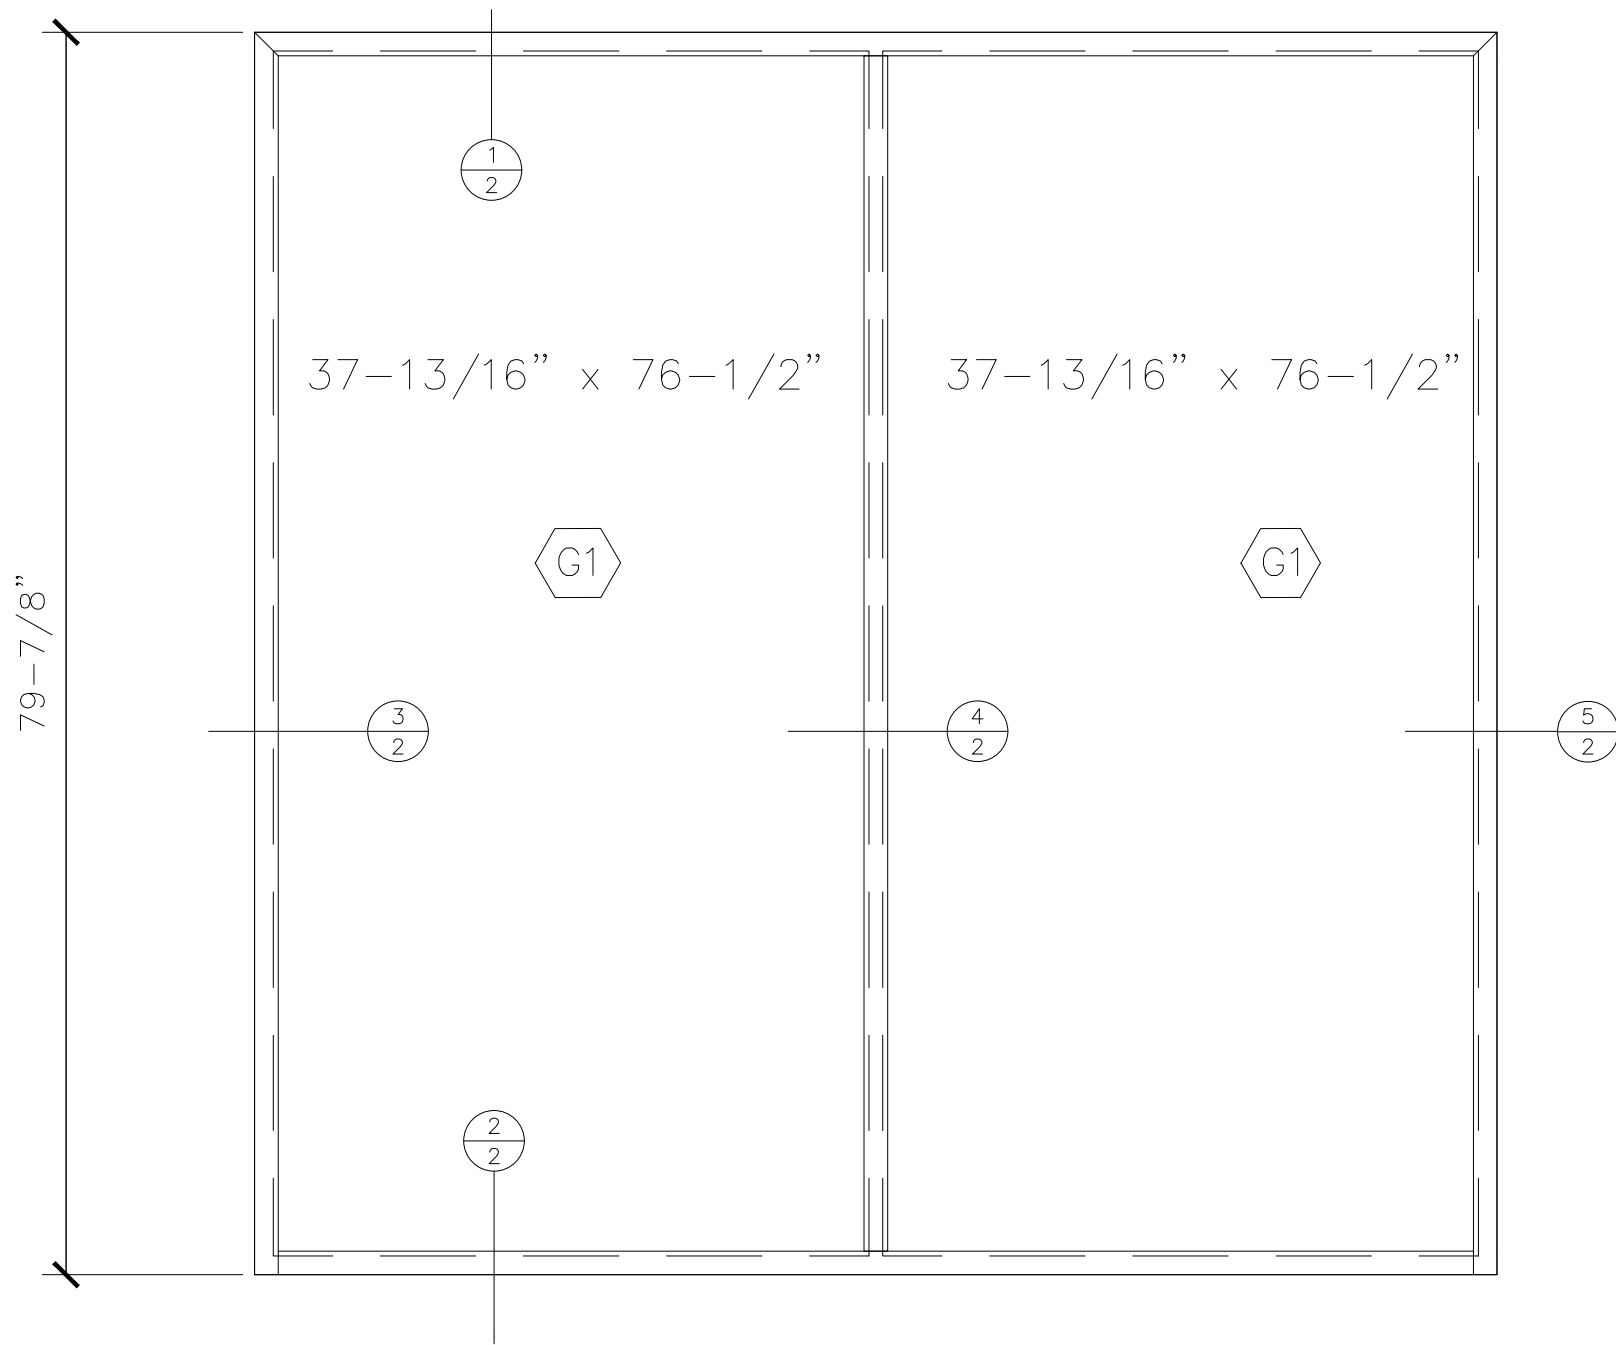

C1	FRAME	487X201	487 HEAD, JAMB, SILL MULLIONS
C2		487X203	487 VERTICAL/HORIZONTAL MULLIONS
C3		487X202	487 FLOOR TRACK
C4		487X215	487 FACE CAP- 1-1/2"
C6		487X214	487 GLAZING ADAPTOR
F1	FASTENERS	20061601	# 6-20X1/2 P.H.P. TEK SCREWS
F2		-----	# 8 X 2-1/2 DRY WALL SCREWS
W1	WTHR STRIP	NP718	INTERIOR SPONGE GASKET
W2		NP225	VINYL GLAZING GASKET
G1	GLASS		1/4" LAMINATED GLASS
G2		SB514	NEOPRENE SETTING BLOCK
H1	HARDWARE	487C1	487 SERIES 90 DEG. CLIP
H2		487C2	487 SERIES "T" CLIP
H3		TCI-93170X330	TREMCO ACOUSTICAL CURTAINWALL SEALANT

REVISIONS



C.R. LAURENCE CO.
ARCHITECTURAL PRODUCTS

2100 E. 38TH Street, Los Angeles, CA 90058
www.crlaurence.com

Job Name:

487 SERIES
OFFICE PARTITION
ACOUSTIC CONTROL SYSTEM

Glazing Contractor:





DATE: 12.20.2016

DRAWN BY: GDO

CHECKED BY: XX

SCALE: AS SHOWN



JOB #: PTC

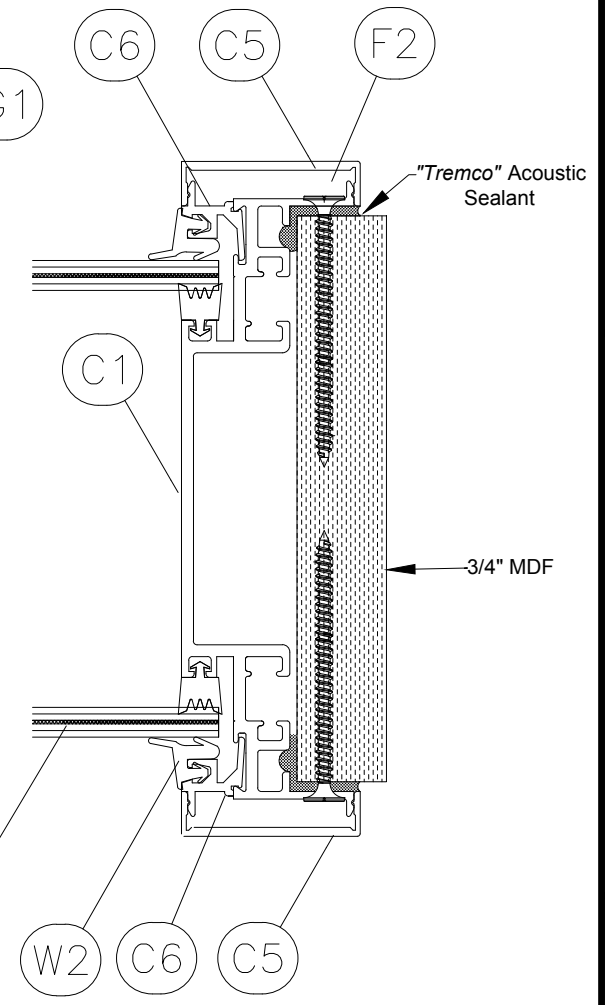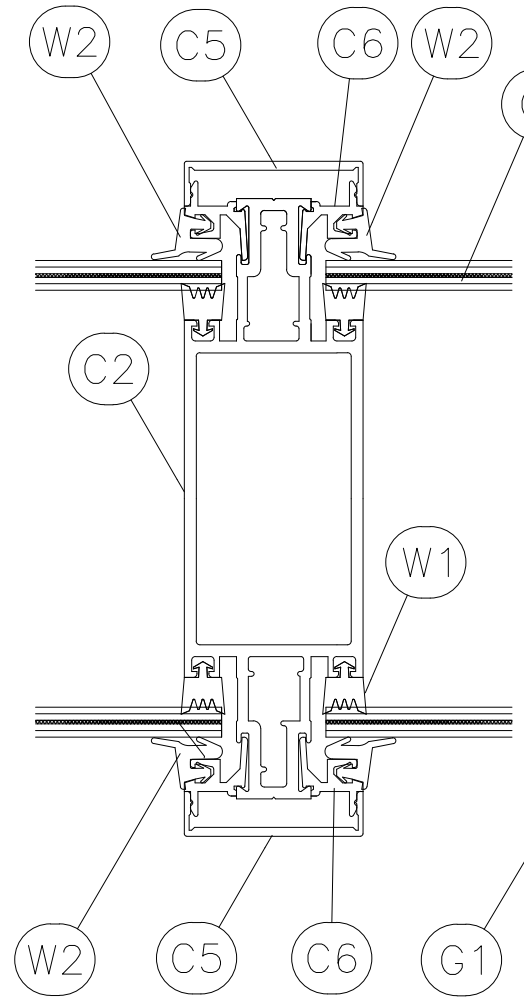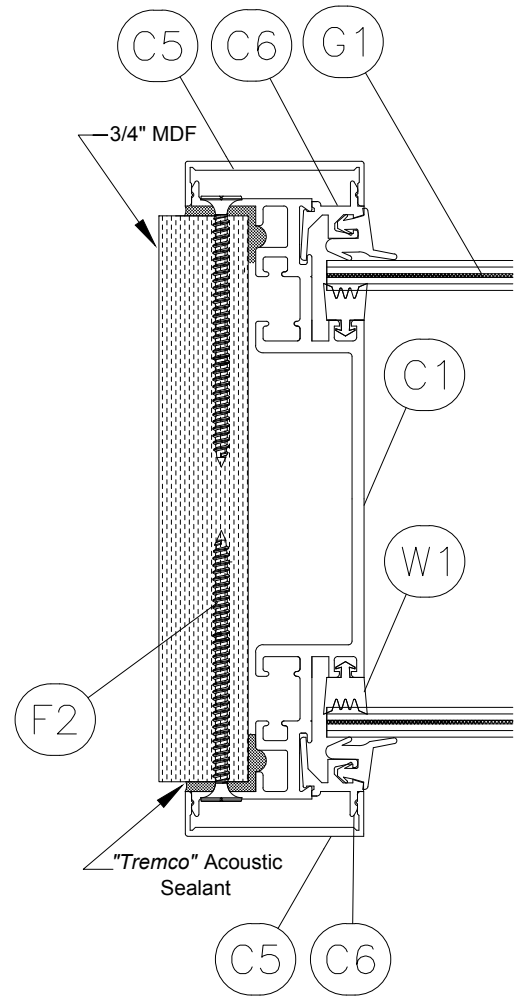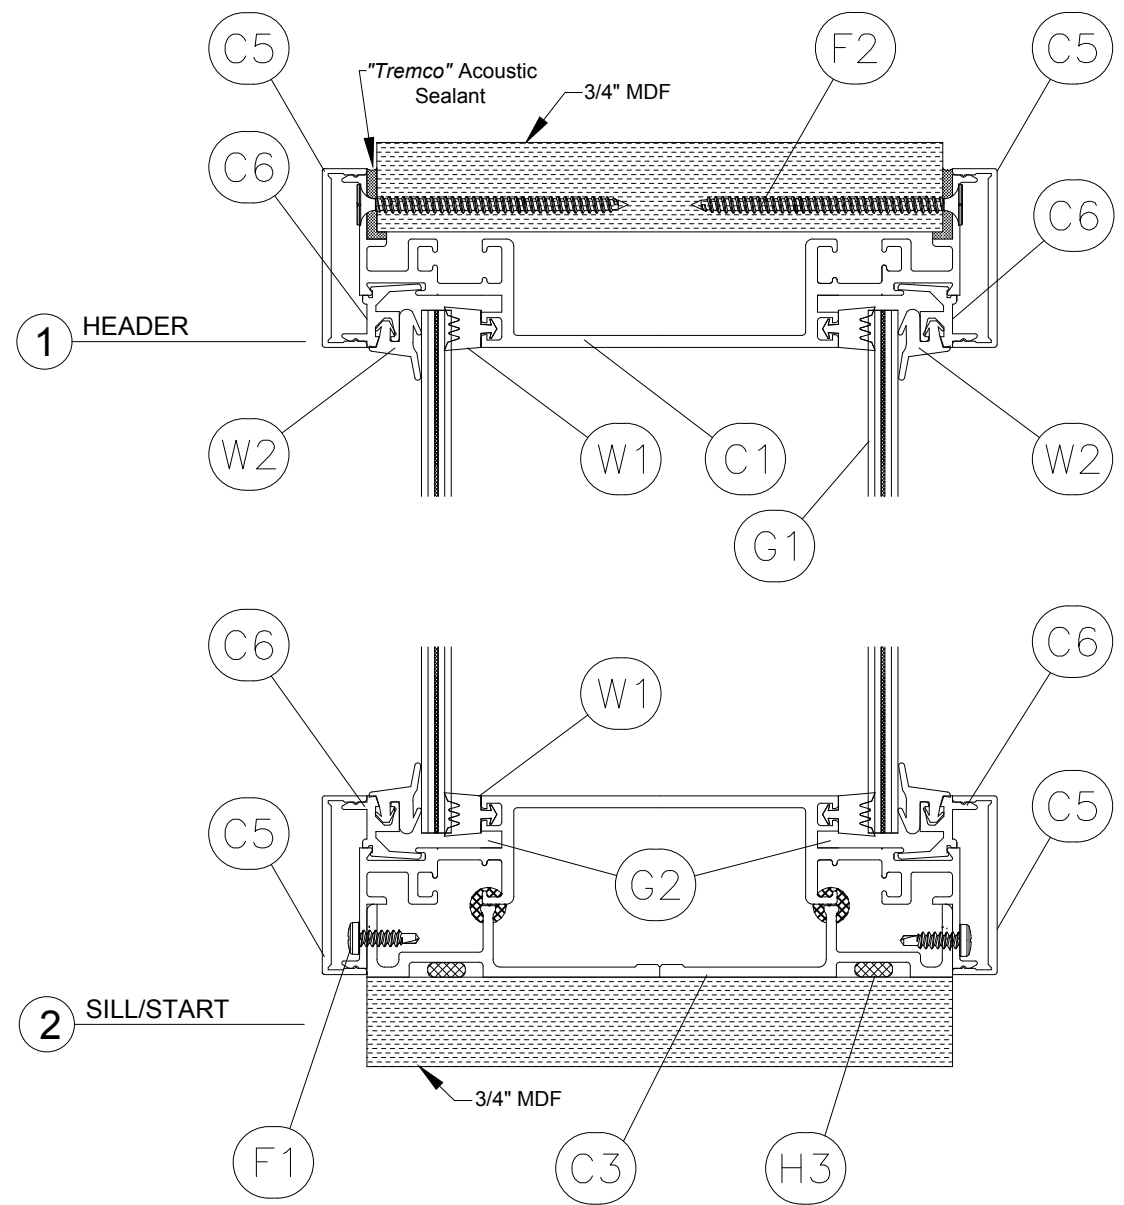


CRL
 C.R. LAURENCE CO.
 ARCHITECTURAL PRODUCTS
 2100 E. 38TH Street, Los Angeles, CA 90058
 www.crlaurence.com

Job Name:
 487 SERIES
 OFFICE PARTITION
 ACOUSTIC CONTROL SYSTEM

DATE:	12.20.2016
DRAWN BY:	GDO
CHECKED BY:	XX
SCALE:	AS SHOWN
JOB #:	PTC

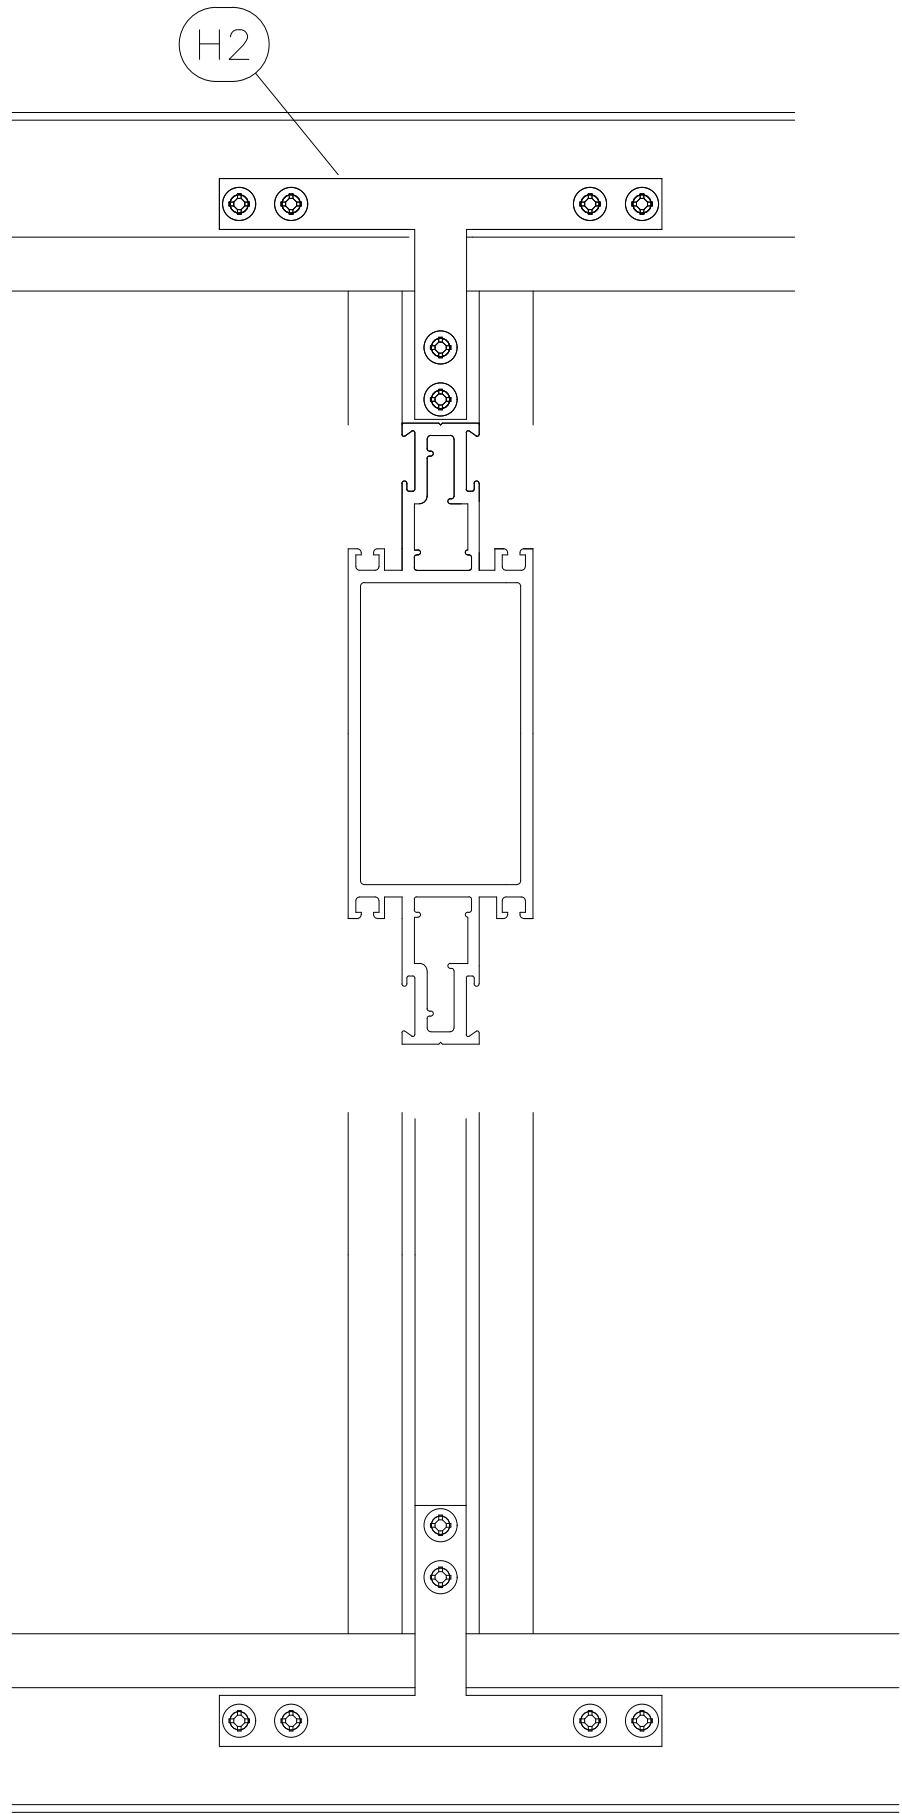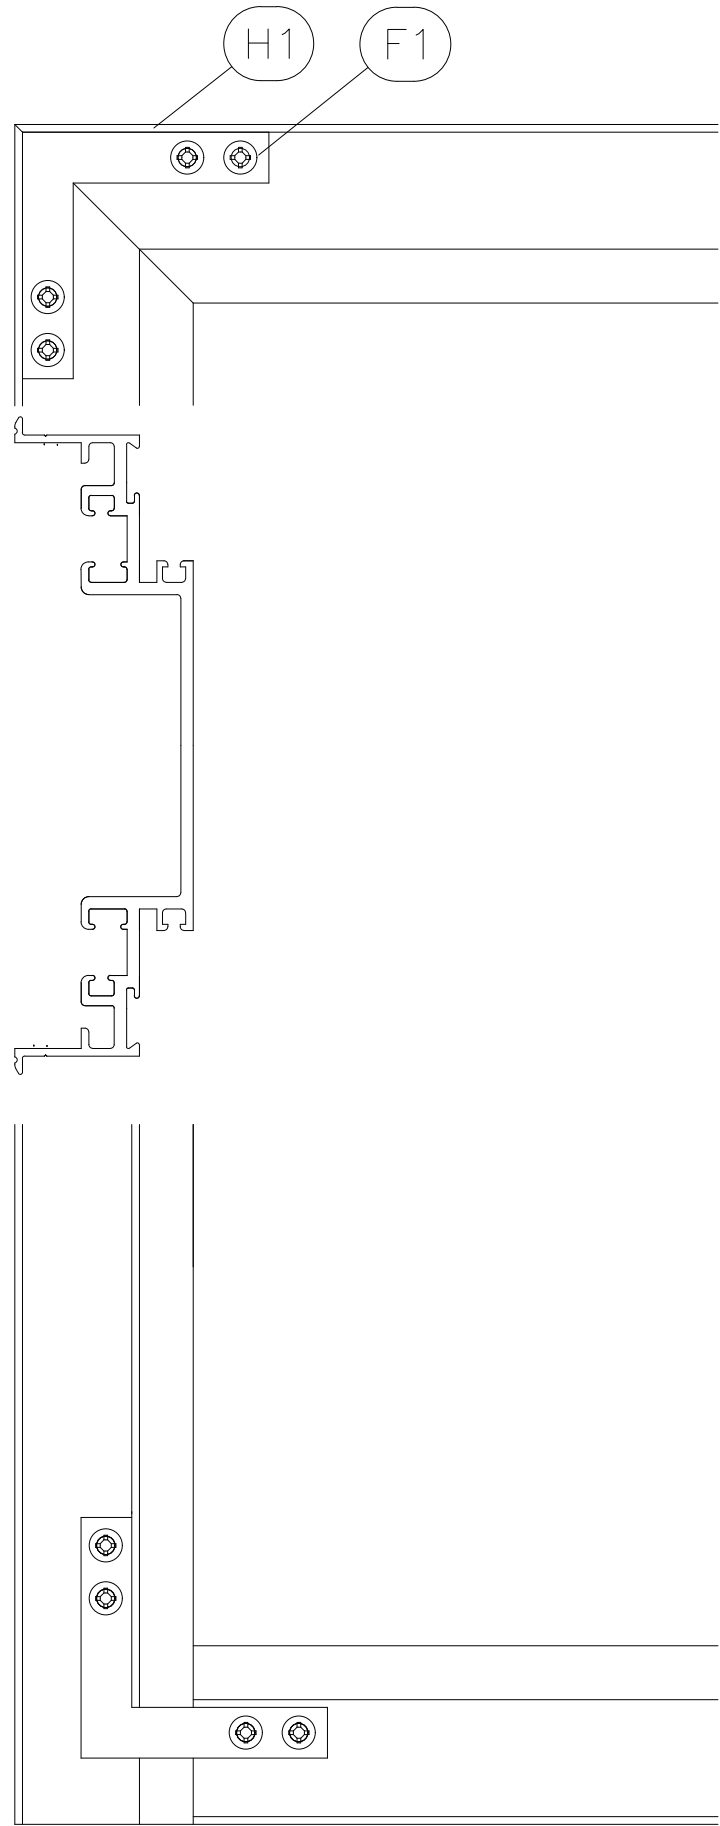

REVISIONS



CRL

C.R. LAURENCE CO.

ARCHITECTURAL PRODUCTS

2100 E. 38TH Street, Los Angeles, CA 90058

www.crlaurence.com

Job Name:

487 SERIES
OFFICE PARTITION
ACOUSTIC CONTROL SYSTEM

DATE: 9-9-2014

DRAWN BY: GDO

CHECKED BY: XX

SCALE: AS SHOWN

JOB #: PTC411852

SHT 3 OF 3